

SPECIFICATIONS**Frequency Response:**

600-6,500 Hz \pm 5dB
(see Figure 1)

Power Handling:

8 hours, 6-dB crest factor:
30 watts
(500-5,000 Hz pink noise)

Impedance,**Nominal:**

8 ohms

Minimum, Above 500 Hz:

6.5 ohms (650 Hz)

Sound Pressure Level at 1 Meter,

1 Watt Input Averaged, Pink Noise
Band-Limited from 500 to 5,000 Hz:
107 dB

Horizontal Beamwidth:

80° @ 2 kHz (see Figure 2)

Vertical Beamwidth:

50° @ 2 kHz (see Figure 2)

Directivity Factor R_0 (Q):

7.9 @ 2 kHz (see Table 1)

Usable Low-Frequency Limit:

400 Hz

Construction:

High impact acrylonitrile butadiene styrene (ABS) with ultraviolet light inhibiting mesa tan finish. Positive-lock painted zinc die cast swivel bracket

Voice-Coil Diameter:

3.81 cm (1.5 in.)

Magnet Weight:

0.28 kg (0.63 lb)

Magnet Material:

Strontium ferrite

Flux Density:

1.25 Tesla

Dimensions,**Height:**

28.0 cm (11.0 in.) PA30
28.0 cm (11.0 in.) PA30T

Width:

16.5 cm (6.5 in.) PA30
16.5 cm (6.5 in.) PA30T

Depth:


21.6 cm (8.5 in.) PA30
29.4 cm (11.6 in.) PA30T

Net Weight:

1.8 kg (4.1 lb) PA30
2.4 kg (5.3 lb) PA30T

Shipping Weight:

2.1 kg (4.6 lb) PA30
2.6 kg (5.8 lb) PA30T

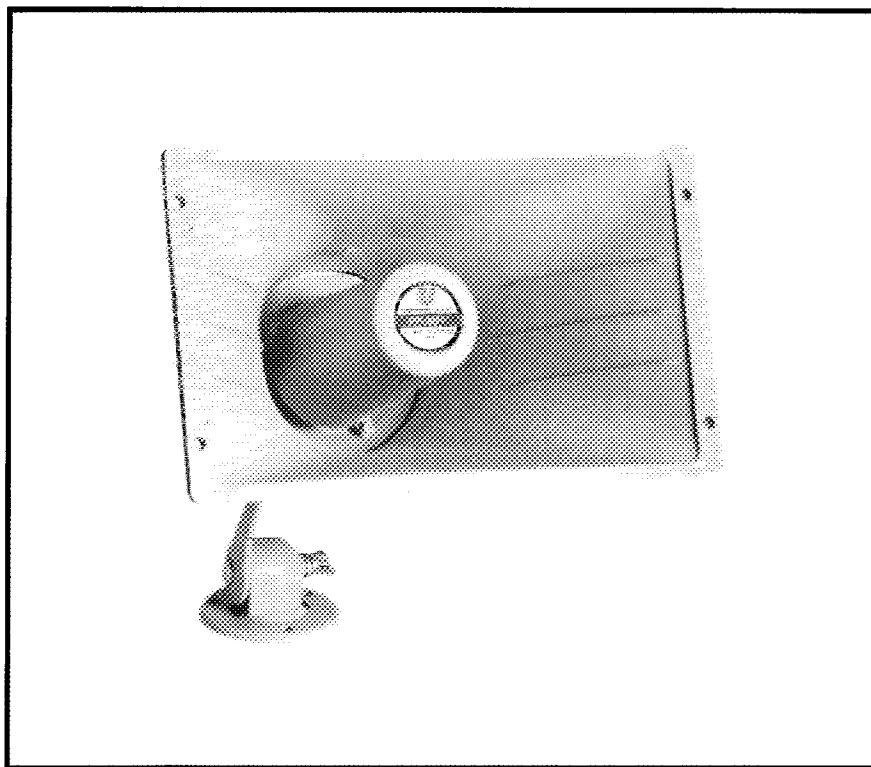**PA30
PA30T****Re-Entrant
Paging Projector****DESCRIPTION**

The University Sound PA30 and PA30T are conservatively rated 30-watt reentrant paging projectors for use in any public address or paging application.

The drivers employ rugged phenolic diaphragms, 1.5-inch diameter voice coils and "rim centered" ferrite magnet structures for long life and reliability under extreme operating conditions.

A 12-inch SJTO-18-2 cable, phased and color coded, is provided for connecting to the PA30.

The transformer model (PA30T) includes connections for 25 V, 70 V and 100 V distributed systems and a screwdriver operated power tap select switch.

A nominal 80° horizontal by 50° vertical coverage pattern together with a low-frequency cutoff of 400 Hz provides excellent articulation in demanding applications.

The PA30 (PA30T) is molded from high-impact ultraviolet inhibiting acrylonitrile butadiene styrene (ABS). A positive lock zinc die cast swivel bracket provides maximum mounting flexibility and ease of installation.

Ideal for both indoor and outdoor applications, these drivers are well suited for any installation requiring rugged, reliable performance.

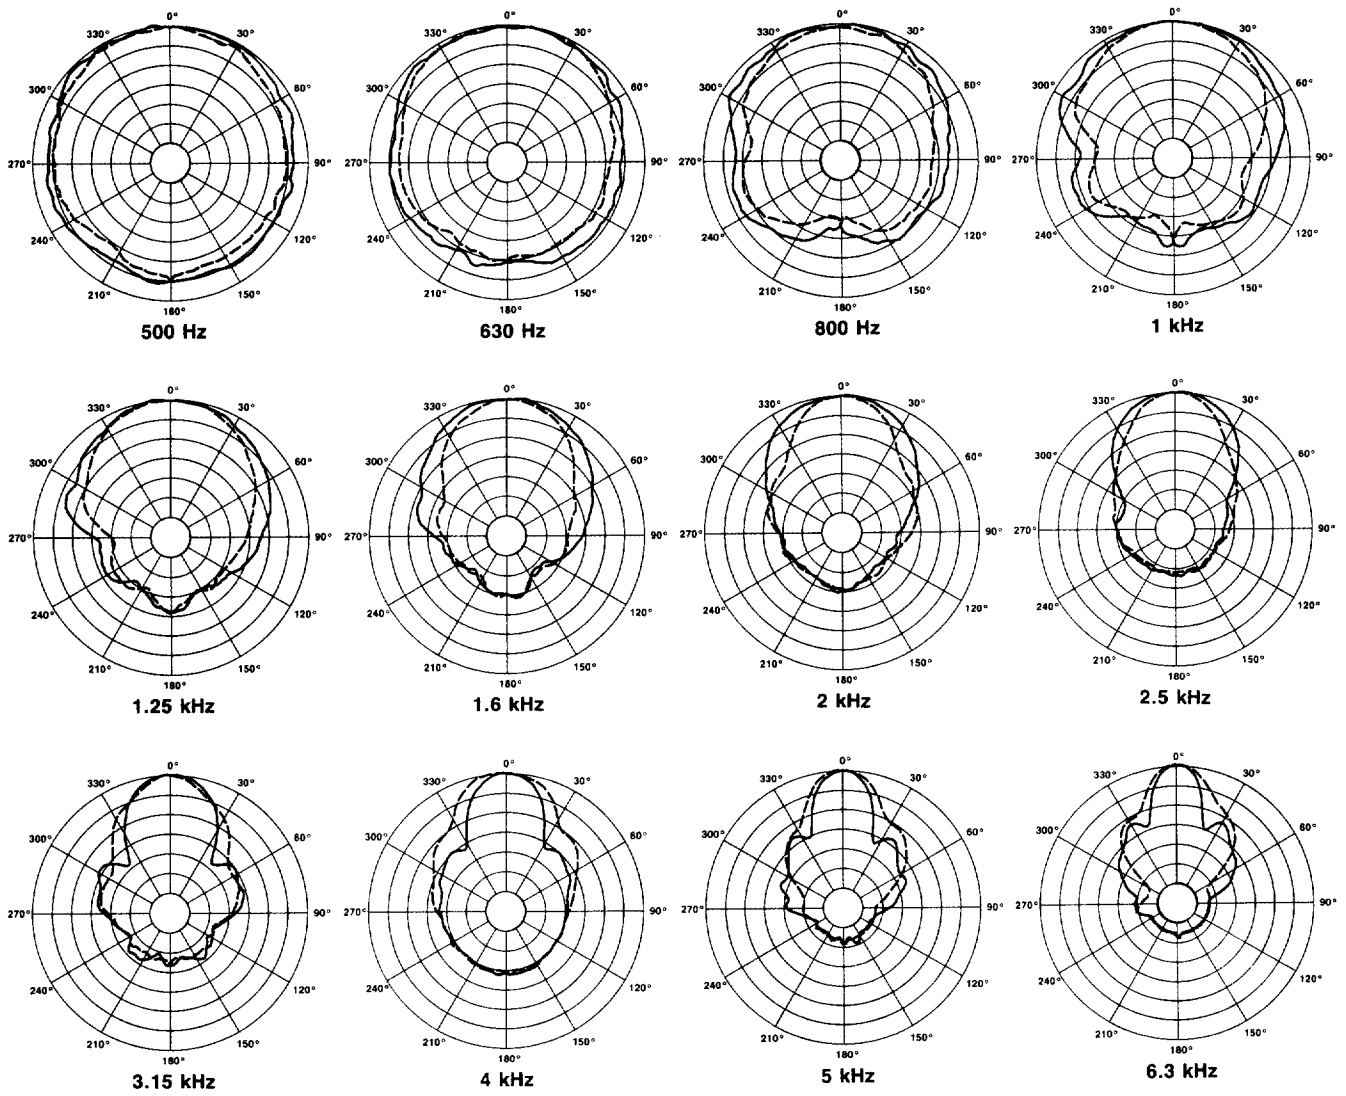


FIGURE 1
PA30 Polar Response

HORIZONTAL ———
VERTICAL - - - -

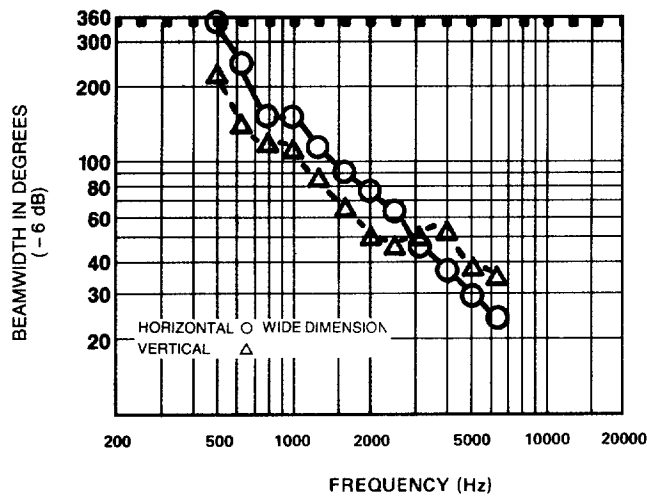


FIGURE 2
PA30 Beamwidth vs. Frequency

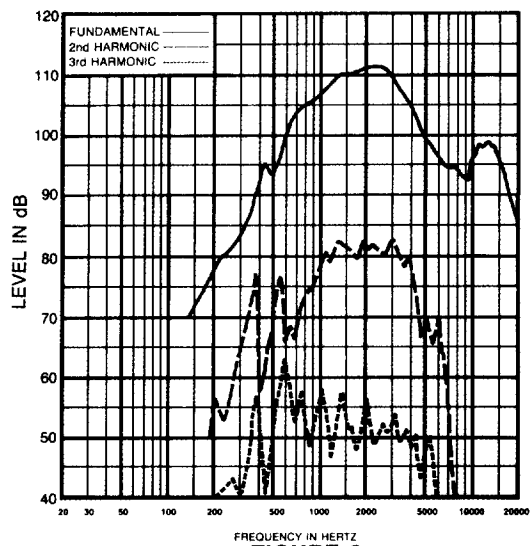


FIGURE 3
PA30 Frequency Response
(1 watt at 1 meter)

POLAR RESPONSE

The directional characteristics of the PA30/PA30T were measured by running a set of horizontal/vertical polar responses, in University's large anechoic chamber, at each one-third-octave center frequency. The test signal was one-third-octave pseudo-random pink noise centered at the indicated frequencies. The measurement microphone was placed 6.1 m (20 ft.) from the horn mouth, while rotation was about the waveguide geometric apexes. These axes of rotation are quite close to apparent (acoustic) apexes across the frequency range of measurement. Errors attributable to the slight differences between the geometric and acoustic apexes are reduced to an inconsequential level by the relatively long, 20-foot measuring distance. The horn was suspended freely with no baffle. The polar plots shown in Figure 1 display the results of these tests. The center frequency is noted on each plot. The wider plot on each chart is the horizontal polar (-) and the narrower plot is the vertical polar (- - -).

BEAMWIDTH

A plot of the PA30/PA30T's 6-dB-down total included beamwidth angle is shown in Figure 2 for each one-third-octave center frequency.

FREQUENCY RESPONSE

Figure 3 shows the axial frequency response of the PA30/PA30T. It was measured at a distance of 1 meter, using a swept sine wave.

INSTALLATION

Removing the Mounting Base

The base may be easily removed to simplify speaker installation. To remove the base, simply back off the single wingnut to approximately the end of its bolt. Remove the base with a sliding motion. **It is not necessary to completely remove either the wingnut or its bolt.** Later, after the base is mounted, the speaker may be reinstalled on the base with a similar sliding motion, adjusted to any angular position, and the wingnut tightened.

Mounting the Base

The removable mounting base has three evenly-spaced holes on a 60.3 mm (2.38 in.) diameter circle. This diameter is small enough to be conveniently mounted on the cover of a standard 4-inch square or octagon electrical outlet box. The base may be used as a template. In addition, the base is slotted for mounting with 1/2-inch steel banding material. Banding tools and materials are available commercially and permit attachment to I-beams, pillars, or similar structural supports, where screw-mounting is impractical. Finally, the base may also be attached to many structural supports with small C-clamps providing appropriate safety measures are observed.

TRANSFORMER MODEL (PA30T)

A transformer and power selector switch are installed in the rear housing.

The level of the PA30T may be adjusted by moving the switch setting (see Table 1); clockwise increases the power. Since the same switch and transformer are used for either the 100-volt, 70-volt or 25-volt line, the power setting depends upon the amplifier output that is used, 100-volt, 70-volt or 25-volt.

PA30T Power	100-Volt Line		70-Volt Line		25-Volt Line	
	Impedance	Capacitance	Impedance	Capacitance	Impedance	Capacitance
30.0 W	333 Ω	2.0 mf	167 Ω	5.0 mf	-	-
15.0 W	666 Ω	1.0 mf	333 Ω	2.0 mf	45 Ω	20.0 mf
7.5 W	1300 Ω	0.5 mf	666 Ω	1.0 mf	89 Ω	10.0 mf
3.7 W	2500 Ω	0.3 mf	1300 Ω	0.5 mf	167 Ω	5.0 mf
1.8 W	-	-	2500 Ω	0.3 mf	333 Ω	2.0 mf

Table 1 — Series Protection Capacitors for 200 Hz and Below

CAUTION: When connected to a 100-volt or 70-volt line do not use the two switch settings marked DO NOT USE as this may result in excessive power driving the PA30T.

LOW-FREQUENCY DRIVER PROTECTION

When frequencies below the low-frequency cutoff for the horn assembly are fed to the driver, excessive current may be drawn by the driver. For protection of driver, amplifier, and transformer (if driver with built-in transformer is used), capacitor(s) in series with driver, or transformer primary are recommended values. The values shown are for 200 Hz. Values for other frequencies can be determined by using the formula:

$$C = \left[C_{200} \times \frac{200}{f} \right]$$

C_{200} = Values shown in the above table

f = New Frequency

For drivers without transformers:
8-ohm driver, 25 V - 100 mf

150 V dc or 150 V non-polarized electrolytic, or two 150 V dc electrolytics of two times required value in series, back to back, for 70-volt lines.

ARCHITECTS' AND ENGINEERS' SPECIFICATIONS

The loudspeaker(s) shall be integral driver and reentrant horns utilizing a rugged phenolic diaphragm and high temperature rated 1.5-inch diameter voice coils.

The axial frequency response will extend from 600 to 6,500 Hz and the horn shall exhibit a low-frequency cutoff of 400 Hz. Sound pressure level will be 107 dB (1W/1M) with a 500-to-5,000 Hz pink noise signal applied, and the horn will produce a horizontal beamwidth of 80° and a vertical beamwidth of 50° at 2.0 kHz.

The loudspeaker(s) shall be capable of handling a 30-watt, 500-to-5,000 Hz pink signal with a 6-dB crest factor for a period of 8 hours.

The horn shall be molded high impact acrylonitrile butadiene styrene (ABS), capable of satisfactory mechanical performance in the temperature range from -40° C (-40°F) to 71° C (160°F) and not subject to sunlight embrittlement. Other major external speaker parts shall be die-cast zinc, finished in a mesa tan baked enamel to match the molded horn parts. All components shall be

resistant to damage from weather, moisture, and fungus.

A serrated, positive-lock swivel bracket shall provide orientation adjustment in all three planes. Vertical adjustments are made by loosening a single wingnut on the mounting base.

The loudspeakers shall be 28.0 cm (11.0 in.) high by 16.5 cm (6.5 in.) wide and 21.6 cm (8.5 in.) deep—PA30, or 29.4 cm (11.6 in.)—PA30T.

The loudspeaker shall be the University Sound PA30T, which includes a 100V/70V/25V line matching transformer and weighs no more than 2.6 kg (5.8 lb), and the University Sound PA30, which has a nominal impedance of 8 ohms and weighs no more than 2.1 kg (4.6 lb).

WARRANTY (Limited) — University Sound Speakers and Speaker Systems (excluding active electronics) are guaranteed for five years from date original purchase against malfunction due to defects in workmanship and materials. If such malfunction occurs, unit will be repaired or replaced (at our option) without charge for materials or labor if delivered prepaid to University Sound. Unit will be returned prepaid. Warranty does not extend to finish, appearance items, burned coils, or malfunction due to abuse or operation under other than specified conditions, including cone and/or coil damage resulting from improperly designed enclosures, nor does it extend to incidental or consequential damages. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above exclusion may not apply to you. Repair by other than University Sound will void this guarantee. This warranty gives you specific legal rights, and you may also have other rights which vary from state to state.

Service and repair address for this product: University Sound, Inc., Phone 818/362-9516, FAX 818/367-5292. Applications and technical information for University Sound products: University Sound, Inc., Technical Coordinator, Phone 818/362-9516, FAX 818/367-5292.

Specifications subject to change without notice.

BASIC GUIDELINES FOR THE USE OF HORNS AND DRIVERS WITHIN A SOUND SYSTEM.

DESIGNING FOR INTELLIGIBILITY AND ADEQUATE SPL

The Basic Idea

Many sound systems would have better performance if the following basic principles are kept in mind. Speakers with the appropriate coverage patterns should be chosen, aimed and powered to achieve a uniform direct field in the highly absorptive audience, with no sound aimed at the reflective wall and ceiling surfaces. Where multiple speakers are required in order to achieve a uniform direct field, their coverage patterns should be only slightly overlapped, so that each section of the audience is covered by a single speaker. To the extent this ideal is achieved, reverberation is minimized and intelligibility is maximized.

The following material explains these concepts in more detail and illustrates two design approaches.

What is Reverberation?

Reverberation is the persistence of sound within an enclosure, such as a room, after the original sound has ceased. Reverberation may also be considered as a series of multiple echoes so closely spaced in time that they merge into a single continuous sound. These echoes decrease in level with successive reflections, and eventually are completely absorbed by the room.

Non-Reverberant Environments

An open, outdoor space is considered to be a non-reverberant environment, as virtually all sound escapes the area without reflection.

Variations in Level Due to Distance for Non-Reverberant Environments

In non-reverberant environments, such as outdoors, sound pressure level will be reduced by half (6 dB) every time the distance from the speaker is doubled (this is called the inverse-square law). Figure A shows the dB losses to be expected as distance from the speaker is increased from the one-meter (3.28-foot) measuring distance typically used in SPL specifications.

Reverberant Environments

Where sound is reflected from walls and other surfaces, there is a point beyond which the "reverberant field" dominates and the sound pressure level is higher and more constant than predicted by using the inverse-square law alone.

Variations in Level Due to Distance for Reverberant Environments


The reverberant field will begin to dominate typically at distances of 10 to 30 feet. This distance is greatest for the least reverberant rooms and speakers with narrow beamwidth angles. The frequency and beamwidth specifications provided by the data sheet are still required to obtain satisfactory distribution of the direct sound (or direct field) from the loudspeaker(s), which still follows the inverse-square law. It is the direct signal that contributes to speech intelligibility. This is why the sound system designer should seek a uniform direct field, with as little reverberant field as possible. For example, consider a single speaker with a wide beamwidth angle used to cover a long, narrow, reverberant room. The direct field will be so far below the reverberant field at the back of the room that speech will probably be unintelligible.

Calculating Variations in Level Due to Changes in Electrical Power

Each time the power delivered to the speaker is reduced by one-half, a level drop of 3 dB occurs. The nomograph of Figure B shows the change in dB to be expected as the power varies from the one-watt input typically used in SPL specifications.

Power Handling

The power rating of a speaker must be known to determine whether a design is capable of meeting the sound pressure level requirements of the system. The power rating combined with the sensitivity will enable a system designer to calculate the maximum sound pressure level attainable at a given distance.

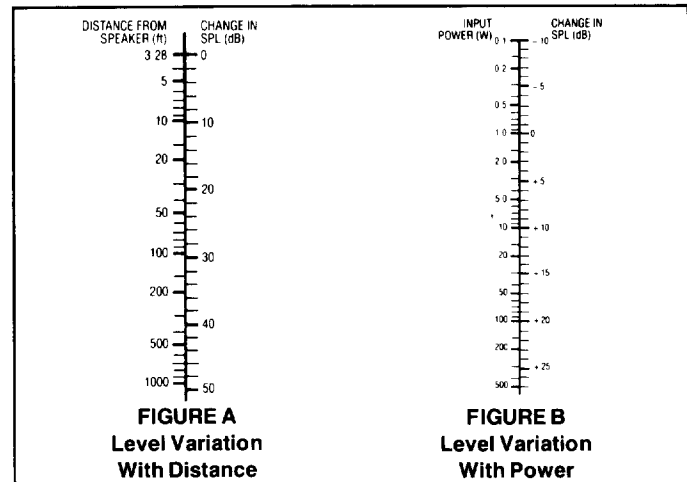

Powering to Achieve Both Average and Peak SPL

The average power that must be delivered to the speaker(s) to achieve the desired average SPL can be determined from the previously presented material on speaker sensitivity, level variation with distance and level variation with power. Enough additional power must be available to reproduce without distortion the short-term peaks that exist in voice and music program. This difference between the peak and average capability of a sound system, when expressed in dB, is often called "peak-to-average ratio," "crest factor" or "headroom." The peaks can be large, as noted earlier: at least 10 times the average (10 dB).

The better sound systems are designed for peaks that are 10 dB above the average, although 6 dB of headroom is sufficient for most general-purpose voice paging systems. The 10-dB peaks require amplifier power ten times that required for the average sound levels. The 6-dB peaks require four times the power.

Utilizing Speaker Beamwidth Information for Maximum Intelligibility

Knowing the beamwidth angle of a loudspeaker can aid in providing a uniform direct field in the listening area. After selecting a desired speaker location, the beamwidth angle needed to adequately cover the listeners without spilling over to the walls or ceilings must be determined. Once these angles are known, the correct speaker can be found by using catalog specifications.

Using Easy-VAMP™ and Floor-Plan Isobars

In some circumstances, it is desirable to use an approach that is more detailed than using the basic horizontal and vertical beamwidth angles. Environments which have excessive reverberation or high ambient noise levels make it especially difficult to achieve the desired SPL and intelligibility.

In recent years, a number of computer-based techniques have been developed to help sound system designers. Some of the more complex systems use personal computers, with relatively sophisticated graphics. Simpler systems, such as Electro-Voice's VAMP™ (Very Accurate Mapping Program), utilize clear overlays and require programmable scientific calculators. However, the hardware/software and training investment required to utilize even the simpler systems are not attractive to some sound system designers. Because of this, University Sound has developed a special adaptation of VAMP, called Easy-VAMP™, which provides a similar design aid without the complexity and cost of the VAMP programs.

More information on both the Easy-VAMP™ and floor-plan isobars can be found in the University Sound Guide.

